

SDM230-M

Smart Single Phase Energy Meter



USER MANUAL 2025 V1.00



Statements

All rights reserved. Without the written permission of the company, no paragraphs or chapters in this manual can be extracted, copied or reproduced in any form. Otherwise, the violator shall bear all consequences.

Eastron reserves all legal rights.

Eastron reserves the right to amend the product specifications in this manual without prior notice. Before placing an order, please contact our company or local agent to get the latest specifications.



CONTENT

Version History	1
Risk Information	2
Chapter 1. Introduction	4
1.1 Product Introduction	4
1.2 Product Characteristics	4
Chapter 2. Technical Parameters	5
2.1 Technical Parameters	5
2.2 Mechanical Characteristics	5
2.3 Performance Criteria	5
2.4 Electromagnetic Compatibility	5
2.5 Safety	6
2.6 Accuracy	6
2.7 Outputs	6
2.8 Dimensions	7
2.9 Wiring Diagram	8
Chapter 3. Operation	10
3.1 Installation Display	10
3.2 Button Functions	11
3.3 Measurements	11
3.4 Auxiliary Mode	15
3.5 Setup Mode	16
Chapter 4. Declaration of Conformity (For MID meter only)	18



Version History

Version	Date	Changes
1.00	2025-3-28	Initial issue



Risk Information

Information for Your Own Safety

This manual does not contain all of the safety measures operating the equipment (module, device) for different conditions and requirements. However, it does contain information which you must know for your own safety and to avoid damages. These information are highlighted by a warning triangle indicating the degree of potential danger.



Warning

This means that failure to observe the instruction can result in death, serious injury or considerable material damage.



Caution

This means hazard of electric shock and failure to take the necessary safety precautions will result in death, serious injury or considerable material damage.

Qualified personnel

Operation of the equipment (module, device) described in this manual may only be performed by qualified personnel. Qualified personnel in this manual means person who are authorized to commission, start up, ground and label devices, systems and circuits according to safety and Regulatory standards.

Proper handling

The prerequisites for perfect, reliable operation of the product are proper transport, proper storage, installation and proper operation and maintenance. When operating electrical equipment, parts of this equipment automatically carry dangerous voltages. Improper handling can therefore result in serious injuries or material damage.

- ♦ Use only insulating tools.
- ♦ Do not connect while circuit is live (hot).
- ♦ Place the meter only in dry surroundings.
- ♦ Do not mount the meter in an explosive area or expose the meter to dust, mildew and insects.
- ♦ Make sure the wires are suitable for the maximum current of this meter.
- Make sure the AC wires are connected correctly before activating the current/voltage to the meter.
- ❖ Do not touch the meter connecting clamps directly with metal, blank wire and your bare hands as you may get electrical shock.
- ♦ Make sure the protection cover is placed after installation.
- ♦ Installation, maintenance and reparation should only be done by qualified personnel.
- ♦ Never break the seals and open the front cover as this might influence the function of the meter, and will cause no warranty.
- ♦ Do not drop, or allow strong physical impact on the meter as the high precisely components inside may be damaged.
- ♦ Designed to be mounted inside of switchboards or cabinet on DIN rail.
- This device must have a suitable sized Circuit Breaker feeding the Multi Function Energy Meter so it



does not exceed the maximum rated current.

- The supply wiring of this device shall be suitable sized cable to match the installed circuit breaker.
- ♦ A Disconnection Device (Circuit Breaker) should be installed close to the Multi Function Energy Meter.
- ♦ The Disconnection Device shall be marked as the Disconnection Device for the Multi Function Energy Meter.

Disclaimer

We have checked the contents of this publication and every effort has been made to ensure that the descriptions are as accurate as possible.

However, deviations from the description cannot be completely ruled out, so that no liability can be accepted for any errors contained in the information given. The data in this manual is checked regularly and the necessary corrections are included in subsequent editions. We are grateful for any improvements that you suggest.



Chapter 1. Introduction

1.1 Product Introduction

SDM230-M measures and displays the characteristics of single phase two wire (1p2w), including voltage, frequency, current, power, active and reactive energy, imported or exported. Energy is measured in terms of kWh, kVArh. Maximum demand current can be measured over preset periods of up to 60 minutes.

The meter is Max. 100A direct connected and do not need to connect with external current transformers(CT). An RS485 communication port is available on the meter for remote data transmission.

1.2 Product Characteristics

- Bi-directional measurement IMP & EXP
- RS485 Modbus RTU
- Multi-parameters measurement
- LCD with white backlit, adjustable backlit time

Measurements:

- Phase voltage: V
- Current: A
- Active power: WReactive power: VAr
- Apparent power: VA
- Apparent power.Frequency: Hz
- Power factor: PF
- Active energy: Ep_imp (import active energy), Ep_exp (export active energy), Ep_total (total active energy)
- Reactive energy: Eq_imp (import reactive energy), Eq_exp (export reactive energy), Eq_total (total reactive energy)
- Maximum demand: MD

Setup:

- RS485 Modbus RTU
- Demand interval time
- Backlit time
- Clear Max. demand info & resettable energy
- Password modification



Chapter 2. Technical Parameters

2.1 Technical Parameters

Voltage AC (Un)	230V AC
Voltage Range	100 - 277V AC(L-N)
Current Input	0.15-10(100)A
Starting Current (Ist)	0.04A
Transition Current (Itr)	1A
Over Current Withstand	30Imax for 0.01S
Frequency Rating Value	50/60Hz
AC Voltage Withstand	4KV/1min
Impulse Voltage Withstand	6kV – 1.2/50μS waveform
Voltage Circuit Power Consumption	≤ 2W/10VA
Current Circuit Power Consumption	≤3VA
Display	LCD with white backlit
Max. reading	999999.9 kWh/kVArh

2.2 Mechanical Characteristics

Net Weight	≈166g	
IP Degree of Protection	IP51 front display	
(IEC 60529)	IP20 whole meter	
Dimensions (DxHxW)	63*100*36mm	
Mounting	DIN Rail 35mm	
Material of Meter Case	Self-extinguishing UL 94 V-0	
Mechanical Environment	M1	

2.3 Performance Criteria

Operation Humidity	≤90% Non-condensing
Storage Humidity	≤95% Non-condensing
Operating Temperature	-40°C~+70°C
Storage Temperature	-40°C~+80°C
Pollution Degree	2
Altitude	≤2000m
Vibration	10Hz to 50Hz, IEC 60068-2-6

2.4 Electromagnetic Compatibility

Electrostatic Discharge	IEC 61000-4-2
Immunity to Radiated Fields	IEC 61000-4-3
Immunity to Fast Transients	IEC 61000-4-4
Immunity to Impulse Waves	IEC 61000-4-5
Conducted Immunity	IEC 61000-4-6
Immunity to Magnetic Fields	IEC 61000-4-8
Immunity to Voltage Dips	IEC 61000-4-11
Radiated Emissions	EN55032 Class B



Conducted Emissions	EN55032 Class B
Conducted Emissions	ENSSUSE CIUSS D

2.5 Safety

Over-voltage Category	CAT III
Installation Category	CAT III
Insulating Encased Meter of Protective	11
Class	II .

2.6 Accuracy

Parameters	Accuracy	Resolution
Voltage	±0.5%	0.1V
Current	±0.5%	0.001A
Frequency	±0.2%	0.01Hz
Power Factor	±0.01	0.001
Active Power	±1%	0.001kW
Reactive Power	±1%	0.001kVAr
Apparent Power	±1%	0.001kVA
Active Energy	Class 1 or 0.5 IEC62053-21	0.01kWh
Active Ellergy	Class B or C EN50470-3:2022	O.OIKVVII
Reactive Energy	Class 2 IEC 62053-23 0.01kVArh	

2.7 Outputs

2.7.1 RS485 Modbus RTU


For Modbus RTU, the following RS485 communication parameters can be configured from the Set-up menu:

Bus Type	RS485
Communication Protocol	Modbus RTU
Baud Rate	1.2k/2.4k/4.8k/9.6k(default)/19.2k /38.4k bps
Address Range	001 to 247
Bus Load	64 PCS
Communication Distance	1000m
Parity Bit	none(default)/ odd / even
Stop Bit	1 or 2
Data Bits	8

2.7.2 Pulse Output

The meter is equipped with pulse output, which is fully isolated from the inside circuit. That generates pulses in proportion to the measured energy. The pulse output is polarity dependent, passive transistor output requiring an external voltage source for correct operation. For this external voltage source, the voltage shall be 5-27V DC, and the maximum input current shall be 27mA DC.





ATTENTION: Pulse output must be fed as shown

in the wiring diagram on the left.


Scrupulously respect polarities and the connection mode.

Opto-coupler with potential-free SPST-NO Contact.

Contact range: 5~27VDC Max. current Input: 27mA DC

Pulse outputs type	Two independent channels of optocoupler passive pulse outputs	
	Туре	kWh/kVArh (total, imported, exported) Default: export kWh
Pulse output 1 (configurable)	Constant	1, 10, 100, 1000 imp/kWh or kVArh Default: 1000 imp/kWh or kVArh
	Width	200, 100, 60mS Default: 100mS
Pulse output 2 (fixed)	Туре	imported kWh
	Constant	1000imp/kWh
	Width	100mS


2.8 Dimensions

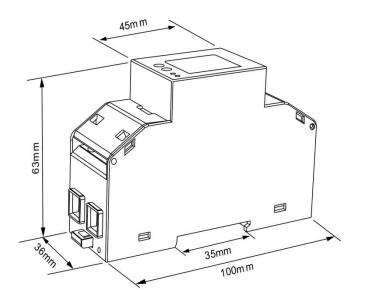

Height: 100mm Width: 36mm Depth: 63mm



2.9 Wiring Diagram

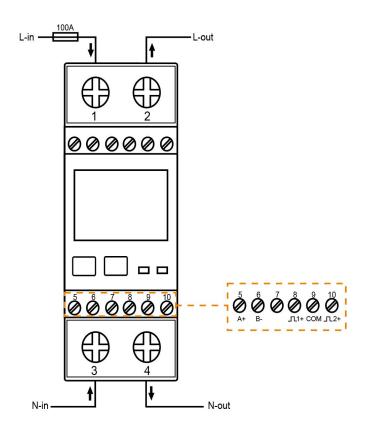

Wiring Guide

	Measurement Connection	Screw Connection
	Strip Length	17-18mm
Terminal	Screw	M7
1~4	Rigid/Supple	4-35mm² (11~2AWG)
	Tightening Torque	3Nm
	Model	PH3
	Measurement Connection	Screw Connection
Terminal	Strip Length	5-6mm
5~(0) (5)(6)	Rigid/Supple	0.5-1.5mm² (22 ~ 14AWG)
	Tightening Torque	0.4Nm
	Model	PHO




Installation


Step 1: Select a 35mm-wide DIN rail, Pull down the back-end clip on the meter to unlock the mounting mechanism.


Step 2: Align Upper Slot with DIN Rail. Position the upper slot of the meter's DIN rail groove onto the DIN rail, ensuring full contact (see Figure 1).

Step 3: Following the direction indicated in Figure 1, engage the lower slot of the DIN rail groove onto the DIN rail until audibly seated (see Figure 2).

Step 4: Push up the back-end clip to lock the meter firmly onto the DIN rail (see Figure 3).










Chapter 3. Operation

3.1 Installation Display

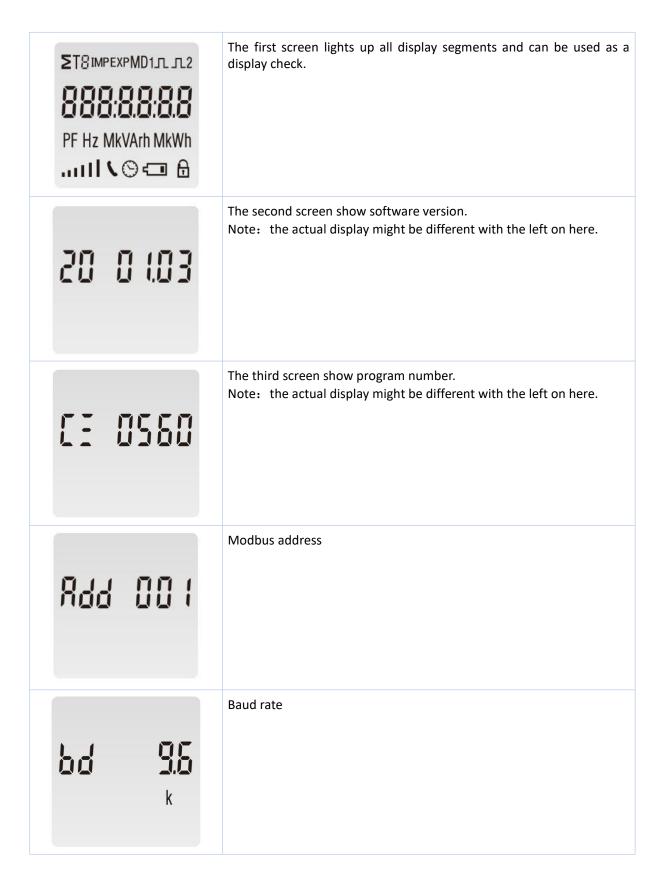



3.2 Button Functions

 ◆ In measurement mode: Short press: switch display screen Long press: cyclic redundancy check code ◆ In setup mode: Short press: next page or increase value Long press: back to previous menu
 ◆ In measurement mode: Long press: enter setup mode ◆ In setup mode: Short press: move the cursor Long press: confirm setting

3.3 Measurements

Each successive pressing of the



button selects a new range

Can be viewed by pressing the button:

Total active energy in kWh \rightarrow Imported active energy in kWh \rightarrow Exported active energy in kWh \rightarrow Resettable total active energy \rightarrow Total reactive energy in kVArh \rightarrow Imported reactive energy in kVArh \rightarrow Exported reactive energy in kVArh \rightarrow Resettable total reactive energy \rightarrow Maximum total power demand \rightarrow Phase to neutral voltage \rightarrow Current of phase \rightarrow Instantaneous active power in W \rightarrow Instantaneous reactive power in VAr \rightarrow Instantaneous volt-amps in VA \rightarrow Power factor \rightarrow Frequency \rightarrow Pulse constant \rightarrow Modbus address \rightarrow Baud rate \rightarrow Total running time



Eastron

38830.38 kWh	Exported active energy in kWh
≥ - 10010.10 kWh	Resettable total active energy
≥ 300 30.30 kVArh	Total reactive energy in kVArh
388 30.38 kVArh	Imported reactive energy in kVArh
38830.38 kVArh	Exported reactive energy in kVArh




Σ 30030.30 kVArh	Resettable total reactive energy
≥ MD 388 W	Maximum total power demand
388.0	Phase to neutral voltage
3.880	Current of phase
388 w	Instantaneous active power W



388 VAr	Instantaneous reactive power in VAr
388 VA	Instantaneous volt-amps in VA
!000 PF	Power factor
50.00 Hz	Frequency
c5t 1000	Pulse constant



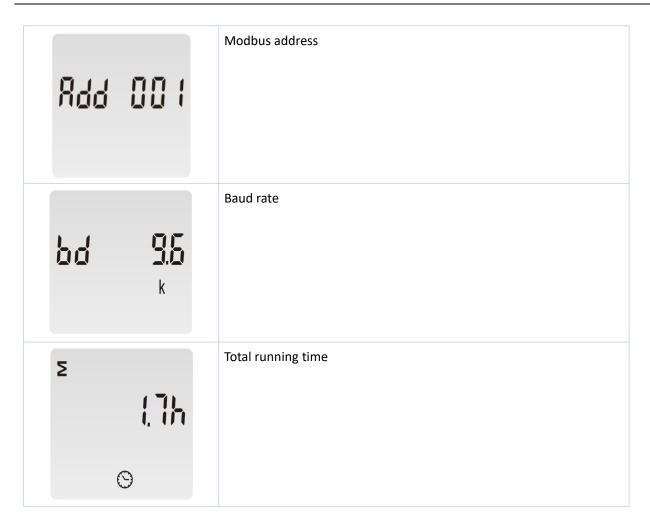

3.4 Auxiliary Mode

Each successive Long pressing of the button enter the auxiliary mode:





3.5 Setup Mode

The meter's settable parameters are password protected. Each successive long pressing on the enter setup mode. Some menu items, such as password, require a four-digit number entry while others, such as baud rate, require selection from a number of menu options.


1.Long press button, after entering the password, long-press again to enter setup mode;
2.Short press button, select the settings menu;
2. Short press button, select the settings menu;
3.Long press button to access the edit interface, short press button to select the required settings,
long-press again to confirm the setting;
4.Long press button to return to the higher menu level.

Settings interface	Set status	Optional configuration
PRS 1000		Password Default: 1000
Rdd 001	844 <mark>0</mark> 0 1	Modbus Address setting Range: 001~247 Default: 001
5d 9.5 k	5d 9.5 k	Baud rate setting Option: 1.2k, 2.4k, 4.8k, 9.6k, 19.2k, 38.4kbps Default: 9.6kbps



Prty N	Prty <mark>N</mark>	Parity bit setting Option: EVEN, ODD, NONE Default: NONE
PL5 out kWh	EXP PL5 QLL kWh	Pulse output setting Option: kWh or kVArh, import, export or total. Default: export kWh
PLS cSt	c5t 1000	Pulse const setting Option: 1, 10, 100, 1000 imp/kWh or kVArh Default: 1000 imp/kWh or kVArh
PLS E	PL5t 100	Pulse duration setting Option: 200, 100, 60mS Default: 100mS
d 12 5EE	d 11≥ 15 ⊗	Demand interval time setting Option: OFF, 5, 10, 15, 30, 60min Default: 15min
Scrl t	Ł 00 5 ⊗	Auto-Cycle display time setting Range: 00~30S Default: 0S

Eastron

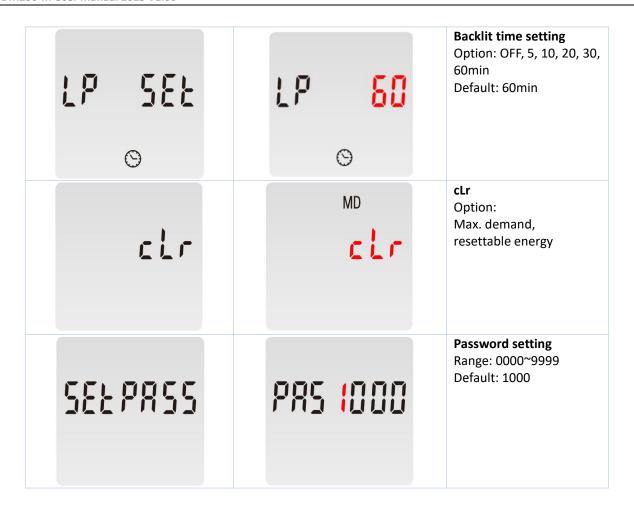

Chapter 4. Declaration of Conformity (For MID meter only)

We, Zhejiang Eastron Electronic Co., Ltd. declares under our sole responsibility as the manufacturer that the three phase multi-function electrical energy meter SDM230-M correspond to the production model described in the EU-type examination certificate and the requirements of the Directive 2014/32/EU. Type examination certificate number T 12800.

Identification number of the Notified Body: 0122.



If you have any question, please feel free to contact our sales team.

Eastron Electronic Co., Ltd.

No. 52, Dongjin Road, Nanhu, Jiaxing, Zhejiang, China Tel: +86-573-83698881 Fax: +86-573-83698883 Email: sales@eastrongroup.com www.eastrongroup.com

